



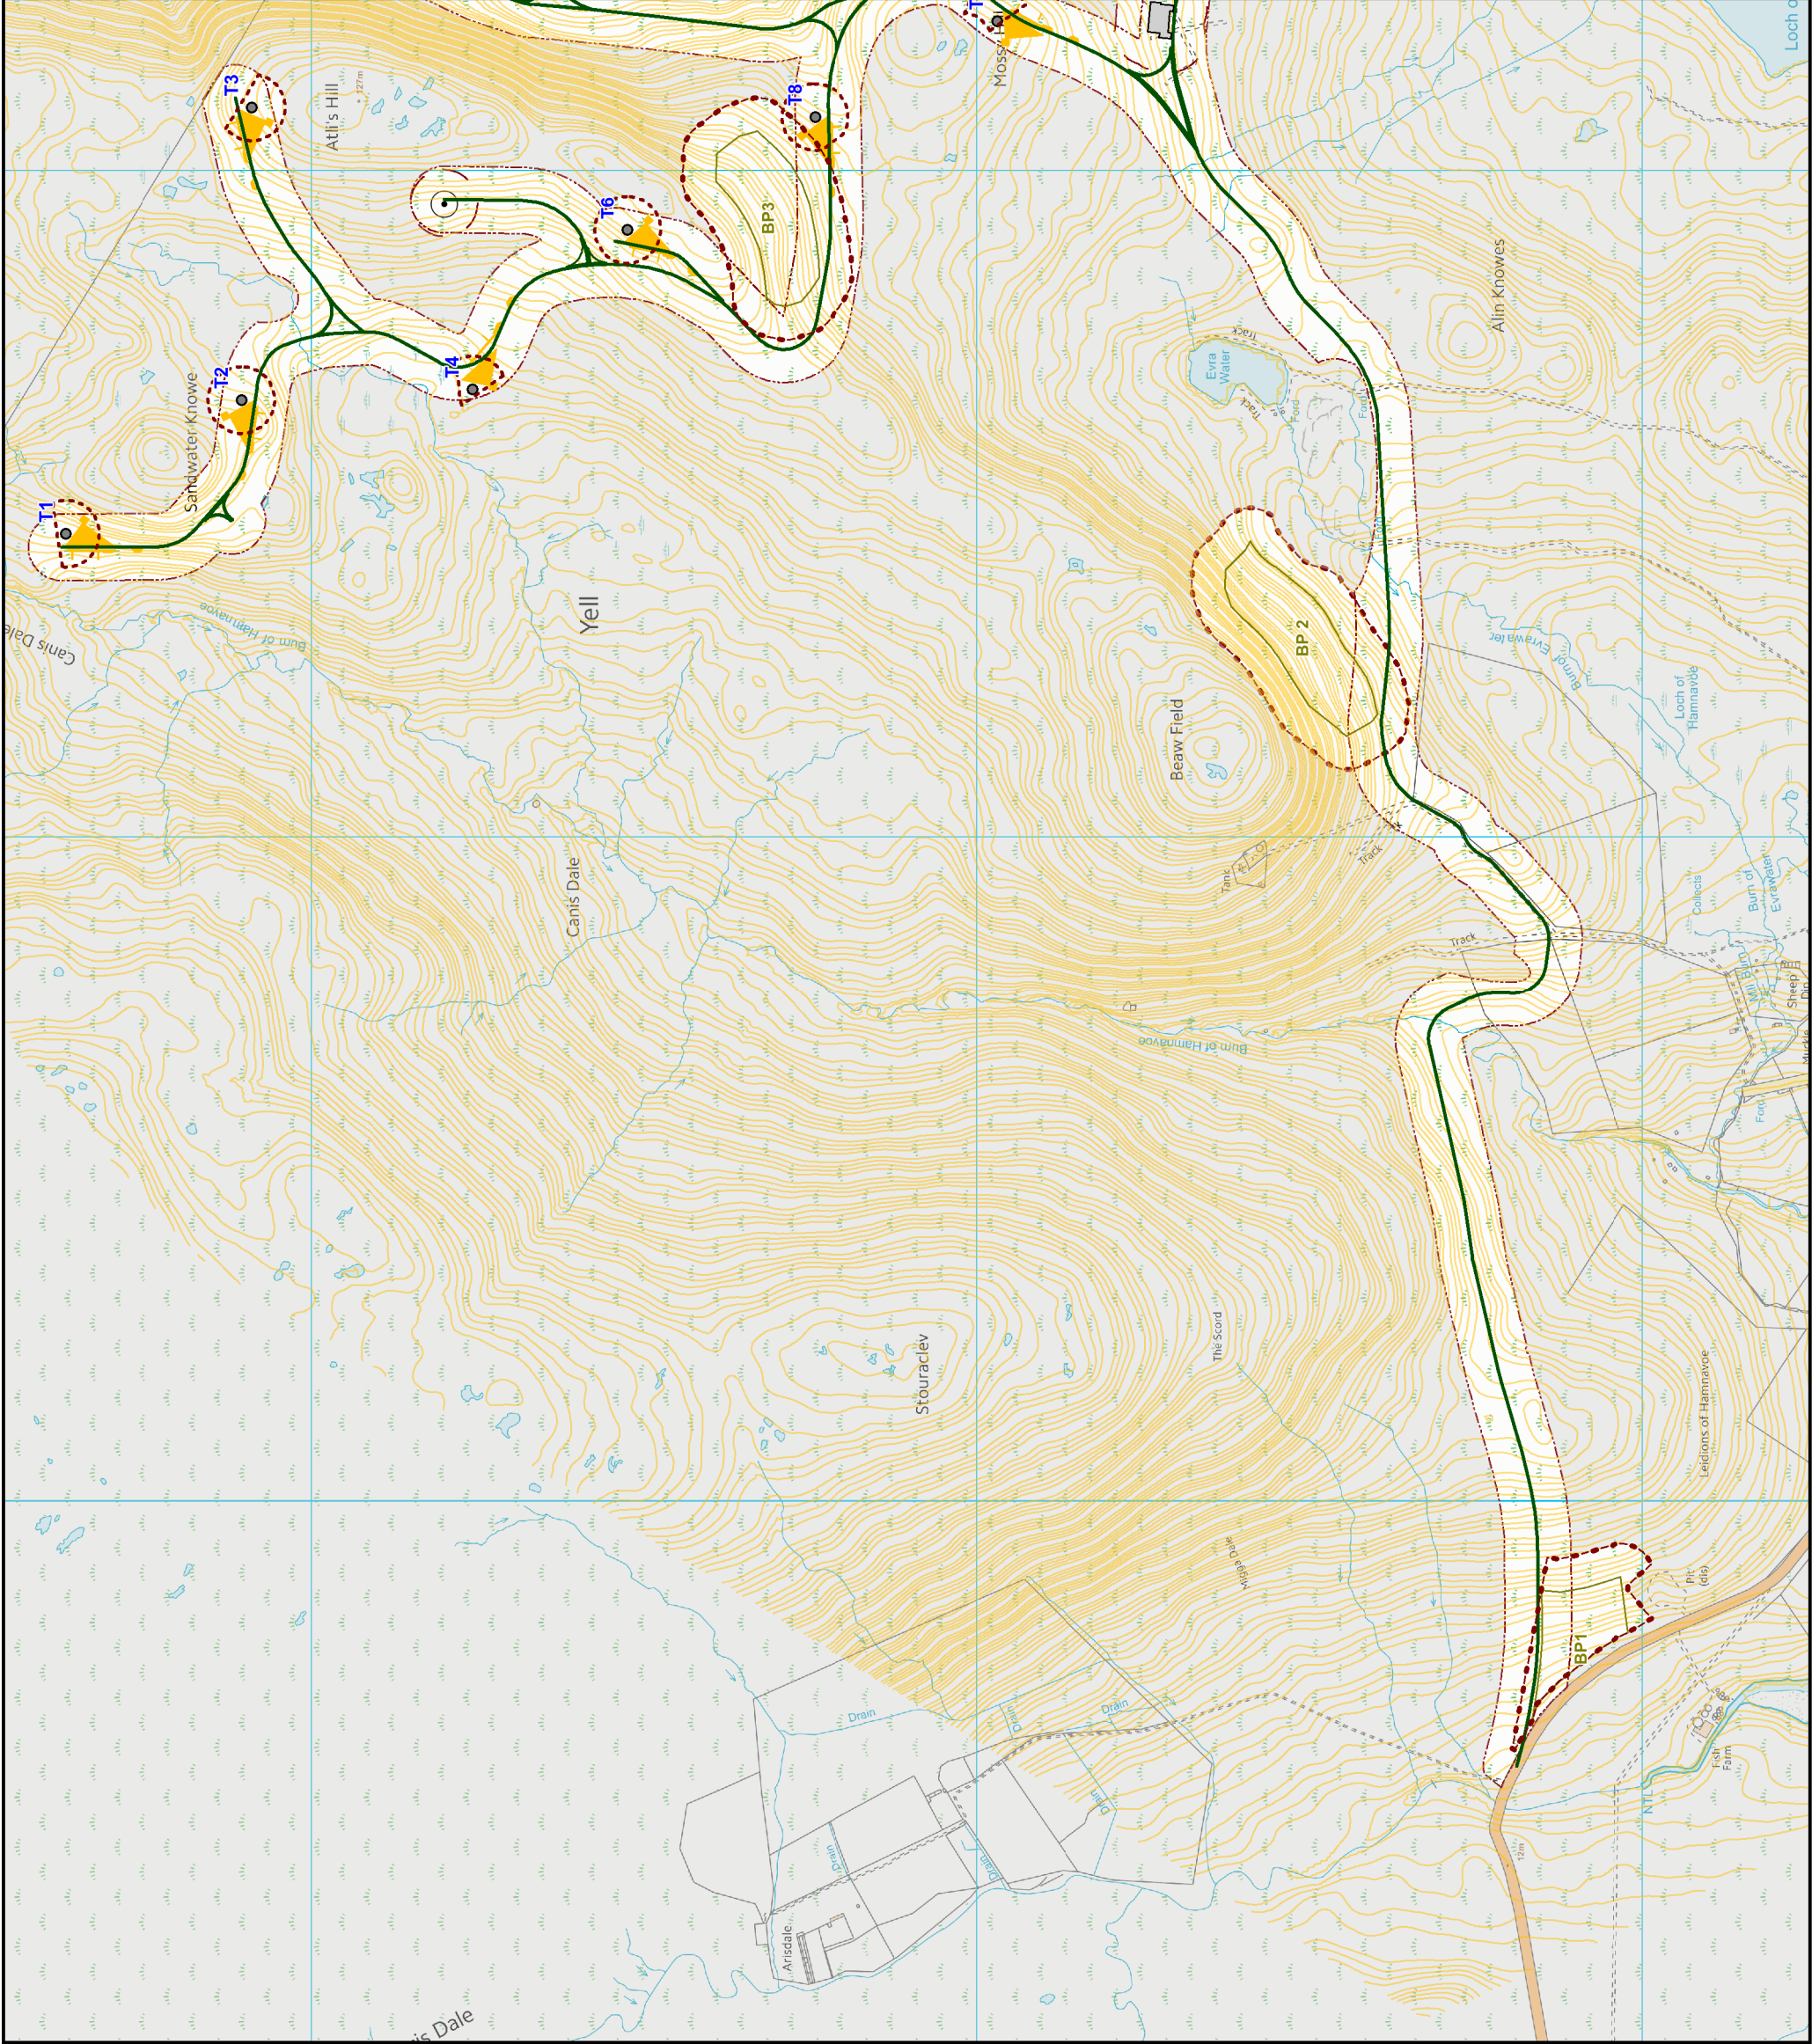

Key

- Location of Turbine Foundations T1 to T17
- Route of Access track
- Borrow Pits
- Hardstanding Areas
- Compound during construction
- Substation
- Anemometry Mast
- 1m contour lines
- Micro-siting allowance**
  - 50m Turbine foundation micro-siting
  - 50m Access track micro-siting
  - 50m Substation, Anemometry Mast and Radio Communication Tower micro-siting
  - 50m Borrow Pit micro-siting

Notes:  
All borrow pits are subject to further design, the sizes shown on this drawing are approx. 30% oversized to allow for local ground conditions.

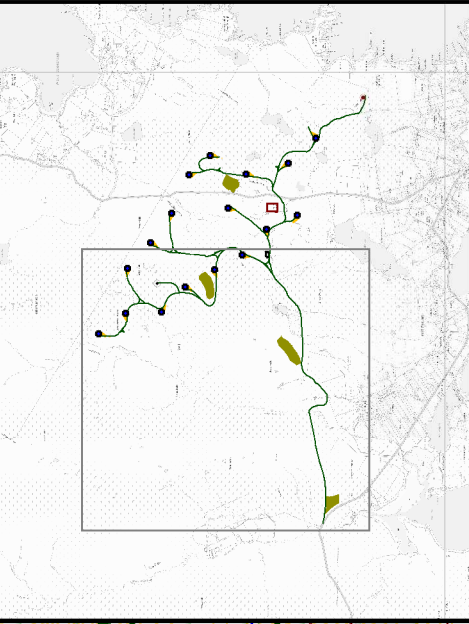

Beaw Field Wind Farm



TITLE:

Micro-siting allowance  
Figure 3.21A

Scale: 1:10,000 @ A3

Date: 22/02/2016



This material has been reproduced from  
Ordnance Survey digital map data with  
the permission of the Controller of  
Her Majesty's Stationary Office  
© Crown Copyright  
License Number 100018933

Ref: